

# Underground Meter Pedestal

**LUCAS HULSEY**  
Energy Services  
Consultant  
~~XXXXXXXXXX~~  
573 - 454 - 5001

Material Furnished & Installed by  
Customer or Contractor

- A. Meter enclosure combo with Safety Lever Py-pass and 200 Amp Main breaker
- B. 2 1/2" Locknut & Bushing
- C. 2 1/2" Conduit Clamp with Lag Screws
- D. 2 1/2" - 24" Radius Sweep Elbow
- E. 2 1/2" Schedule 40 PVC Conduit
- F. 1/2" Box Adapter
- G. 1/2" Conduit (optional)
- H. Ground Wire #4 Bare Copper
- I. Ground Rod - 8' Copper Clad
- J. Ground Rod Clamp
- K. 2) 2" Heavy Wall Steel Posts with Cross Braces
- L. 2 1/2" Expansion Joint


AmerenMo Furnished Material

Service cable installed in Residential conduit.  
Meter installed by Ameren

Note: Contact local inspection authority for their requirements

To Pole, Transformer, or Secondary Pedestal

To Residence

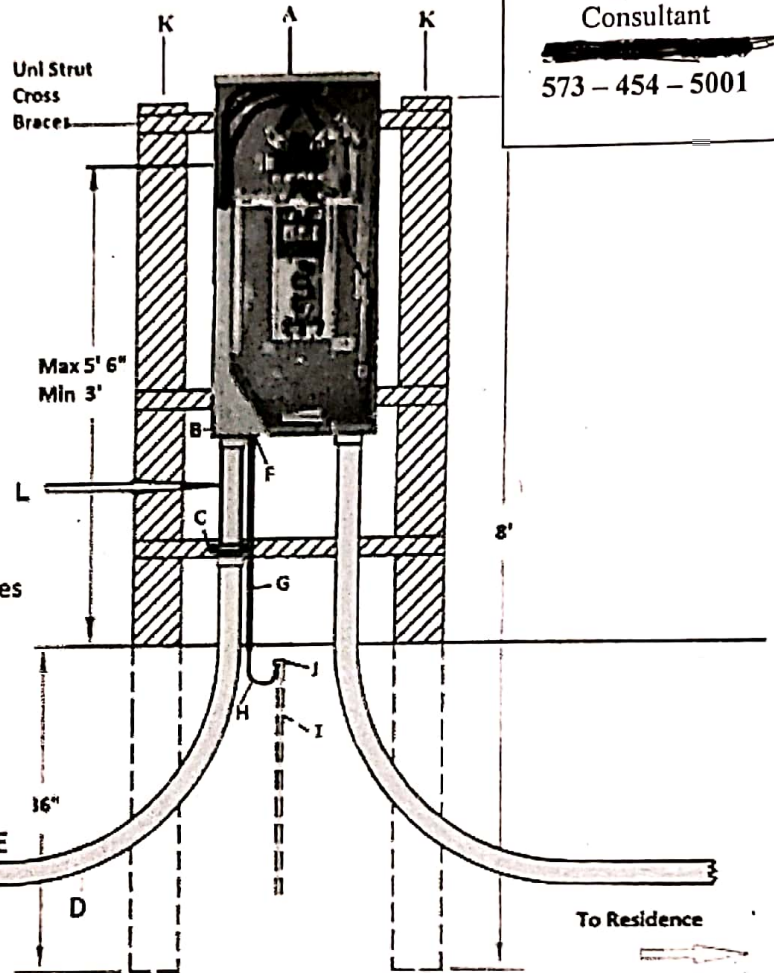

For Energy Efficiency Improvement  
**REBATES**  
Go to  
[AmerenMissouri.com/ActOnEnergy](http://AmerenMissouri.com/ActOnEnergy)  
Start saving today!

Refer to the  
*Ameren Service Manual*  
for a complete list of company requirements.  
[www.Ameren.com/servicemanual](http://www.Ameren.com/servicemanual)

